By using these standard plans, the user agrees to release the County of San Diego from any and all claims, liabilities, suits, and demands on account of any injury, damage, or loss to persons or property, including injury or death, or economic losses, arising | DIF out of the use of these construction documents. The use of these plans does not eliminate or reduce the user's responsibility to verify any and all information.

BMP LEGEND	SHEET INDEX			
PDS 659 BROW DITCH $\Longrightarrow$	Sheet No. SHEET NAME			
PDS 659 BERM ————————————————————————————————————	SP-1 SITE PLAN			
DIRECTION OF LOT DRAINAGE ->	A1 FLOOR PLAN			
MATERIALS & WASTE MANAGEMENT BMPs:	A2 ELECTRICAL PLAN			
WM-1 MATERIAL DELIVERY & STORAGE	A3 ELEVATIONS - FRONT & BACK			
	A4 ELEVATIONS - RIGHT & LEFT			
WM-4 SPILL PREVENTION AND CONTROL	A5 ROOF PLAN / TRUSS LAYOUT			
WM-8 CONCRETE WASTE MANAGEMENT	A6 SECTIONS			
WM-5 SOLID WASTE MANAGEMENT	S1 FOUNDATION PLAN			
WM-9 SANITARY WASTE MANAGEMENT	S2 ROOF FRAMING			
WM-6 HAZARDOUS WASTE MANAGEMENT	CS-1 MIN. CONSTRUCTION SPECIFICATIONS			
EMPORARY RUNOFF CONTROL BMPs:	GENERAL CODES			

#### GENERAL CODES

THIS PROJECT SHALL COMPLY WITH THE FOLLOWING BUILDING CODES AND ASSOCIATED COUNTY OF SAN DIEGO AMENDMENTS:

- 2022 CALIFORNIA RESIDENTIAL CODE
- 2022 CALIFORNIA BUILDING CODE
- 2022 CALIFORNIA GREEN BUILDING STANDARDS CODE 2022 CALIFORNIA ELECTRICAL CODE
- 2022 CALIFORNIA MECHANICAL CODE
- 2022 CALIFORNIA PLUMBING CODE
- 2022 CALIFORNIA FIRE CODE
- SC-2 / PDS 659 SEDIMENT / DESILTING BASIN
- 2022 CALIFORNIA BUILDING ENERGY EFFICIENCY STANDARDS

## **DESIGN BASIS**

CONVENTIONAL LIGHT FRAME CONSTRUCTION

**ROOF LIVE LOAD: 20 PSF ULTIMATE WIND SPEED: 110 MPH EXPOSURE CATEGORY: C** SITE CLASS: D RISK CATEGORY: II

S<sub>DS</sub>: 1.25 SEISMIC DESIGN CATEGORY: D<sub>2</sub>

ALLOW SOIL VERTICAL BEARING PRESSURE: 1500 PSF TC-2 CONSTRUCTION ROAD STABILIZATION ALLOW SOIL LATERAL BEARING PRESSURE: 100 PSF/FT

#### **ENERGY EFFICIENCY SPECIAL FEATURES**

SPECIFY AS INDICATED IN CF1R FORM (TITLE 24):

# **ENERGY EFFICIENCY HERS VERIFICATION**

SPECIFY AS INDICATED IN CF1R FORM (TITLE 24):

BASELINE BMPs FOR POLLUTANT-GENERATING SOURCES

SD-I CONSTRUCT SURFACES FROM PERMEABLE MATERIALS

SS-2 **PRESERVATION OF EXISTING VEGETATION**  $\sim$ PEV $\sim$ PEV $\sim$ 

SS-3 BONDED OR STABILIZED FIBER MATRIX (WINTER) ~M ~M ~

SS-6 / SS-8 STRAW OR WOOD MULCH \sim S/W \sim S/W \sim

SS-7 PHYSICAL STABILIZATION (WINTER) ~ EBM ~ EBM ~

SS-4 **HYDROSEEDING (SUMMER)** ~TSP ~TSP ~

SS-10 ENERGY DISSIPATOR

SC-1 SILT FENCE

SC-5 FIBER ROLLS ——FR——FR—

SC-7 STREET SWEEPING AND VACUUMING

SC-10 STORM DRAIN INLET PROTECTION

TC-3 ENTRANCE / EXIT TIRE WASH

SD-B DIRECT RUNOFF TO PERVIOUS AREAS

SD-G CONSERVE NATURAL FEATURES

SD-K SUSTAINABLE LANDSCAPING

SD-H PROVIDE BUFFERS AROUND WATER BODIES

SD-C INSTALL GREEN ROOF

SD-E INSTALL RAIN BARRELS

SC-6 / SC-8 GRAVEL OR SAND BAGS  $\infty$ 

NS-2 DEWATERING FILTRATION —— DW)—— DW)——

TC-1 STABILIZED CONSTRUCTION ENTRANCE

BASELINE BMPs FOR EXISTING AND PROPOSED SITE FEATURES

SC-A **OVERHEAD COVERING** 

SC-B SEPARATION OF FLOWS FROM ADJACENT AREAS

SC-C WIND PROTECTION

SC-D SANITARY SEWER

SC-E CONTAINMENT SYSTEM

POTENTIAL RUNOFF POLLUTANTS:

A TRASH & REFUSE STORAGE B MATERIALS & EQUIPMENT STORAGE

C LOADING & UNLOADING

D **FUELING** 

E MAINTENANCE & REPAIR F VEHICLE & EQUIPMENT CLEANING


G OTHER

PROPERLY COMPLETED AND SIGNED CERTIFICATES OF INSTALLATION (CF2R FORMS) SHALL BE PROVIDED TO THE INSPECTOR IN THE FIELD. FOR PROJECTS REQUIRING HERS VERIFICATION, THE CF2R FORMS SHALL BE REGISTERED WITH A CALIFORNIA-APPROVED HERS PROVIDER DATA REGISTRY." CF2R FORMS ARE AVAILABLE AT HTTP://WWW.SDCOUNTY.CA.GOV/PDS/BLDG/ENERGY-STDS.HTML.

(CBEES 10-103)

PROPERLY COMPLETED CERTIFICATES OF VERIFICATION (CF3R FORMS) SHALL BE PROVIDED TO THE INSPECTOR IN THE FIELD FOR ITEMS REQUIRING HERS VERIFICATION. CF3R FORMS SHALL BE REGISTERED WITH A CALIFORNIA-APPROVED HERS PROVIDER DATA REGISTRY." CF3R FORMS ARE AVAILABLE AT HTTP://WWW.SDCOUNTY.CA.GOV/PDS/BLDG/ENERGY-STDS.HTML. (CBEES 10-103)

PROVIDE SOLAR PV SYSTEM UNDER SEPARATE PERMIT.



ENGINEERING SCALE: 1" =

ICINITY MAP	OWNER INFORMATION	CONTACT INFORMATION	PROJECT INFORMATION	PERV	IOUS AREA INFORMATION	IMPERVIOUS AREA INFO	RMATION	SHEET TITLE
	NAME:	NAME:	PROJECT SCOPE: PROPOSED 1200 SF DETACHED DWELLING UNIT ADU ☐ SFD ☐	PER	VIOUS SURFACE AREA TABLE	IMPERVIOUS SURFACE ARE	EA TABLE	
	ADDRESS:	ADDRESS:	APN:	SITE PERVIOUS ITEM	M DIMENSIONS AREA (SF) NOTES	SITE IMPERVIOUS ITEM DIMENSION	NEW or REPLACED AREA (SF)	PLOT PLAN
	DUONE	PHONE	SITE ADDRESS:			1 PROPOSED DWELLING UNIT ADU SFD PER PLAN 2	N 1538	SHEET NUMBER
	PHONE:	PHONE:	PROPERTY CONNECTED TO THE ELECTRICAL GRID ( Y or N )  PROPERTY SERVICED BY PROPANE ( Y or N ) IF YES, SHOW TANK ON PLOT PLAN  All proposed buildings, structures, additions, modifications buildings/structures must comply with the approved location, shown on the County approved Plot Plan. At the discretion of County the report of the proposed buildings and the proposed buildings are proposed buildings.	as PERVIOUS ELEMENT M.	ANUFACTURER: LOPE AND DIRECTION OF SLOPE:	3 4		
	EMAIL:	EMAIL:	PROPERTY SERVICED BY NATURAL GAS ( Y or N )  ENTIRE LOT IS FUEL MODIFIED ( Y or N ) IF NO, DIMENSION 100' FUEL MODIFICATION ZONE  County, the property owner may be required to provide proof current placement of each on the parcel. This may include stamped and signed setback certificate prepared by a Califor licensed surveyor or civil engineer. (County Building County 100' FUEL MODIFICATION ZONE	a PERVIOUS ELEMENT CI	AM:ROSS SECTION LOCATED ON SHEET:	TOTAL (SF)  LAND DISTURBANCE: SF		SP-1

FLOOR PLAN NOTES

(WITHOUT SPRINKLERS)

SHOWER COMPARTMENT SEAT

2. SHOWER GRAB BARS

OUTSIDE DIAMETER

BELOW AND AT ENDS

SHOWER FLOOR - SINGLE-LEVER DESIGN

TWISTING OF WRIST

FROM SEAT WALL

ROLL—IN SHOWERS

- MINIMUM 59 INCH LONG HOSE

THE FOLLOWING:

MOUNTING WALL WHEN FOLDED

- NOT EXTENDING OVER SHOWER SEAT

BETWEEN WALL AND GRAB BAR

BATHROOM FINISHED FLOOR.

3. OPENINGS:

PENETRATIONS:

EXTERIOR WALLS WITHIN 3 FEET OF PROPERTY LINE (WITH SPRINKLERS) OR 5 FEET OF PROPERTY LINE (WITHOUT SPRINKLERS)

- 1-HOUR FIRE RATING ON THE UNDERSIDE WITHIN 3FT OF

- 1-HOUR FIRE RATING ON THE UNDERSIDE WITHIN 5FT OF

- MAXIMUM 25% OF WALL AREA WITHIN 5 FEET OF PROPERTY LINE

- 1-HOUR FIRE-RATED PENETRATIONS OF WALLS WITHIN 3FT OF

- 1-HOUR FIRE-RATED PENETRATIONS OF WALLS WITHIN 5FT OF

5. CONCRETE LANDING WITH MIN 36" DEPTH AND A MAXIMUM OF  $1-\frac{1}{2}$ "

OPTIONAL ROLL-IN SHOWER PLAN NOTES

- MUST BE FOLDING TYPE, NOT TO EXCEED MORE THAN 6 INCHES FROM

- MOUNTED MINIMUM 17 INCHES AND MAXIMUM 19 INCHES ABOVE

- SEAT INSTALLED ON SIDE WALL ADJACENT TO CONTROLS AND EXTENDING

- STRUCTURAL ADEQUACY OF MOUNTING HARDWARE AND FASTENERS TO ACCOMMODATE 250 POUND POINT LOAD APPLIED AT ANY POINT ON THE

- MOUNTED MINIMUM 33 INCHES AND MAXIMUM 36 INCHES ABOVE SHOWER

- IF CROSS SECTION IS CIRCULAR, MINIMUM  $1-\frac{1}{4}$ " AND MAXIMUM 2"

- IF CROSS SECTION IS NON-CIRCULAR, MINIMUM 4" AND MAXIMUM 4.8"

– GRAB BARS MOUNTED ADJACENT TO A WALL,  $1-\frac{1}{2}$  ABSOLUTE SPACE

- MINIMUM  $1-\frac{1}{2}$  SPACE BETWEEN GRAB BAR AND PROJECTING OBJECTS

- MINIMUM 12 INCH SPACE BETWEEN GRAB BAR AND PROJECTING OBJECTS

- SURFACE MATERIAL OF ANY WALLS OR OBJECTS ADJACENT TO GRAB BARS MUST BE FREE OF SHARP OR ABRASIVE ELEMENTS AND HAVE ROUNDED

- STRUCTURAL ADEQUACY OF MOUNTING HARDWARE AND FASTENERS TO ACCOMMODATE 250 POUND POINT LOAD APPLIED AT ANY POINT ON THE

- INSTALLED ON BACK WALL OF SHOWER COMPARTMENT ADJACENT TO SEAT

- LOCATED ABOVE GRAB BAR BUT NO HIGHER THAN 48 INCHES ABOVE

- CENTERLINE AT MINIMUM 39 INCHES AND MAXIMUM 41 INCHES ABOVE

- OPERABLE WITH ONE HAND AND WITHOUT TIGHT GRASPING, PINCHING, OR

- OPERABLE PARTS, INCLUDING HANDLE, TO BE INSTALLED ON BACK WALL

- OPERABLE PARTS LOCATED ABOVE GRAB BAR BUT NO HIGHER THAN 48

- ADJUSTABLE -HEIGHT SHOWER HEADS ON VERTICAL BAR SHALL NOT

WHERE SOAP DISHES ARE PROVIDED, MAXIMUM 40 INCHES ABOVE SHOWER

MAXIMUM 1/2" HIGH THRESHOLDS WITH MAXIMUM 50% BEVELED SLOPE AT

8. WHERE DRAINS ARE PROVIDED AT ROLL—IN SHOWERS, MAXIMUM  $\frac{1}{4}$  GRATE

AGING-IN-PLACE AND FALL PREVENTION DESIGN

FLUSH WITH WALL FRAMING ON BOTH SIDE WALLS OF THE FIXTURE.

LANDING. (SECTION R327.1.4). SHOW DIMENSION ON ELEVATION.

BATHROOM OR BEDROOM IS NOT LOCATED ON THE ENTRY LEVEL.

REINFORCEMENT FOR GRAB BARS: AT LEAST ONE BATHROOM ON THE ENTRY LEVEL SHALL BE PROVIDED WITH REINFORCEMENT INSTALLED IN ACCORDANCE WITH SECTION R327.1.1. REINFORCEMENT SHALL BE MINIMUM 2X8 SOLID LUMBER, LOCATED BETWEEN 32" AND 39-1/4" ABOVE THE FINISHED FLOOR

ELECTRICAL OUTLETS, SWITCH, AND CONTROL HEIGHTS SHALL BE LOCATED NO

MORE THAN 48" MEASURED FROM THE TOP OF THE OUTLET BOX AND NO

LESS THAN 15" MEASURED FROM THE BOTTOM OF THE OUTLET BOX ABOVE

DOORBELL BUTTONS SHALL NOT EXCEED 48" ABOVE EXTERIOR FLOOR OR

INTERIOR DOORS: EFFECTIVE JULY 1, 2024, AT LEAST ONE BATHROOM AND

ONE BEDROOM ON THE ENTRY LEVEL SHALL PROVIDE A DOORWAY WITH .

NET CLEAR OPENING OF NOT LESS THAN 32 INCHES, MEASURED WITH TH

DOOR POSITIONED AT AN ANGLE OF 90 DEGREES FROM THE CLOSE POSITION; OR, IN THE CASE OF A TWO- OR THREE-STORY SINGLE FAMILY DWELLING, ON THE SECOND OR THIRD FLOOR OF THE DWELLING IF A

THE FINISHED FLOOR (SECTION R327.1.2). SHOW DIMENSION ON ELEVATION.

- CAPABLE FOR USE AS FIXED SHOWER HEAD AND HAND HELD SHOWER

OF SHOWER COMPARTMENT MINIMUM 19 INCHES AND MAXIMUM 27 INCHES

INCHES ABOVE SHOWER FLOOR, MEASURED TO TOP OF MOUNTING

4. SPRAYER UNIT AND ASSOCIATED OPERABLE PARTS SHALL BE PROVIDED PER

- LOCATED MINIMUM 19 INCHES AND MAXIMUM 27 INCHES FROM SEAT WALL

GRAB BAR, FASTENER, MOUNTING DEVICE, OR SUPPORTING STRUCTURE - WALL REINFORCEMENT TO BE PROVIDED AT LOCATION OF GRAB BARS (E.G.

OPERABLE PARTS OF SHOWER CONTROLS AND FAUCETS:

- OPERABLE WITH MAXIMUM 5 POUNDS OF FORCE

- ON/OFF CONTROL WITH NON-POSITIVE SHUT OFF

FLOOR AND WITHIN REACH LIMITS FROM THE SHOWER SEAT

6. MAXIMUM 2.1% SLOPE IN ALL DIRECTIONS OF ROLL-IN SHOWER FLOORS

OBSTRUCT USE OF BATHTUB GRAB BARS

OPENINGS FLUSH WITH SHOWER FLOOR SURFACE

PERIMETER AND MAXIMUM  $2-\frac{1}{4}$ " CROSS SECTION DIMENSION

GRAB BAR, FASTENER, MOUNTING DEVICE, OR SUPPORTING STRUCTURE

FROM BACK WALL TO POINT WITHIN 3 INCHES OF SHOWER COMPARTMENT

REQUIRE 1-HOUR FIRE RATING FOR EXPOSURE TO BOTH SIDES.

- PROHIBITED WITHIN 2 FEET OF PROPERTY LINE

PROPERTY LINE (WITH SPRINKLERS)

PROPERTY LINE (WITH SPRINKLERS)

LOWER THAN TOP OF DOOR THRESHOLD

PROPERTY LINE (WITHOUT SPRINKLERS)


- PROHIBITED WITHIN 3FT OF PROPERTY LINE

PROPERTY LINE (WITHOUT SPRINKLERS)

- LOCATED WITHIN 27 INCHES OF SHOWER CONTROLS



Sheet Number

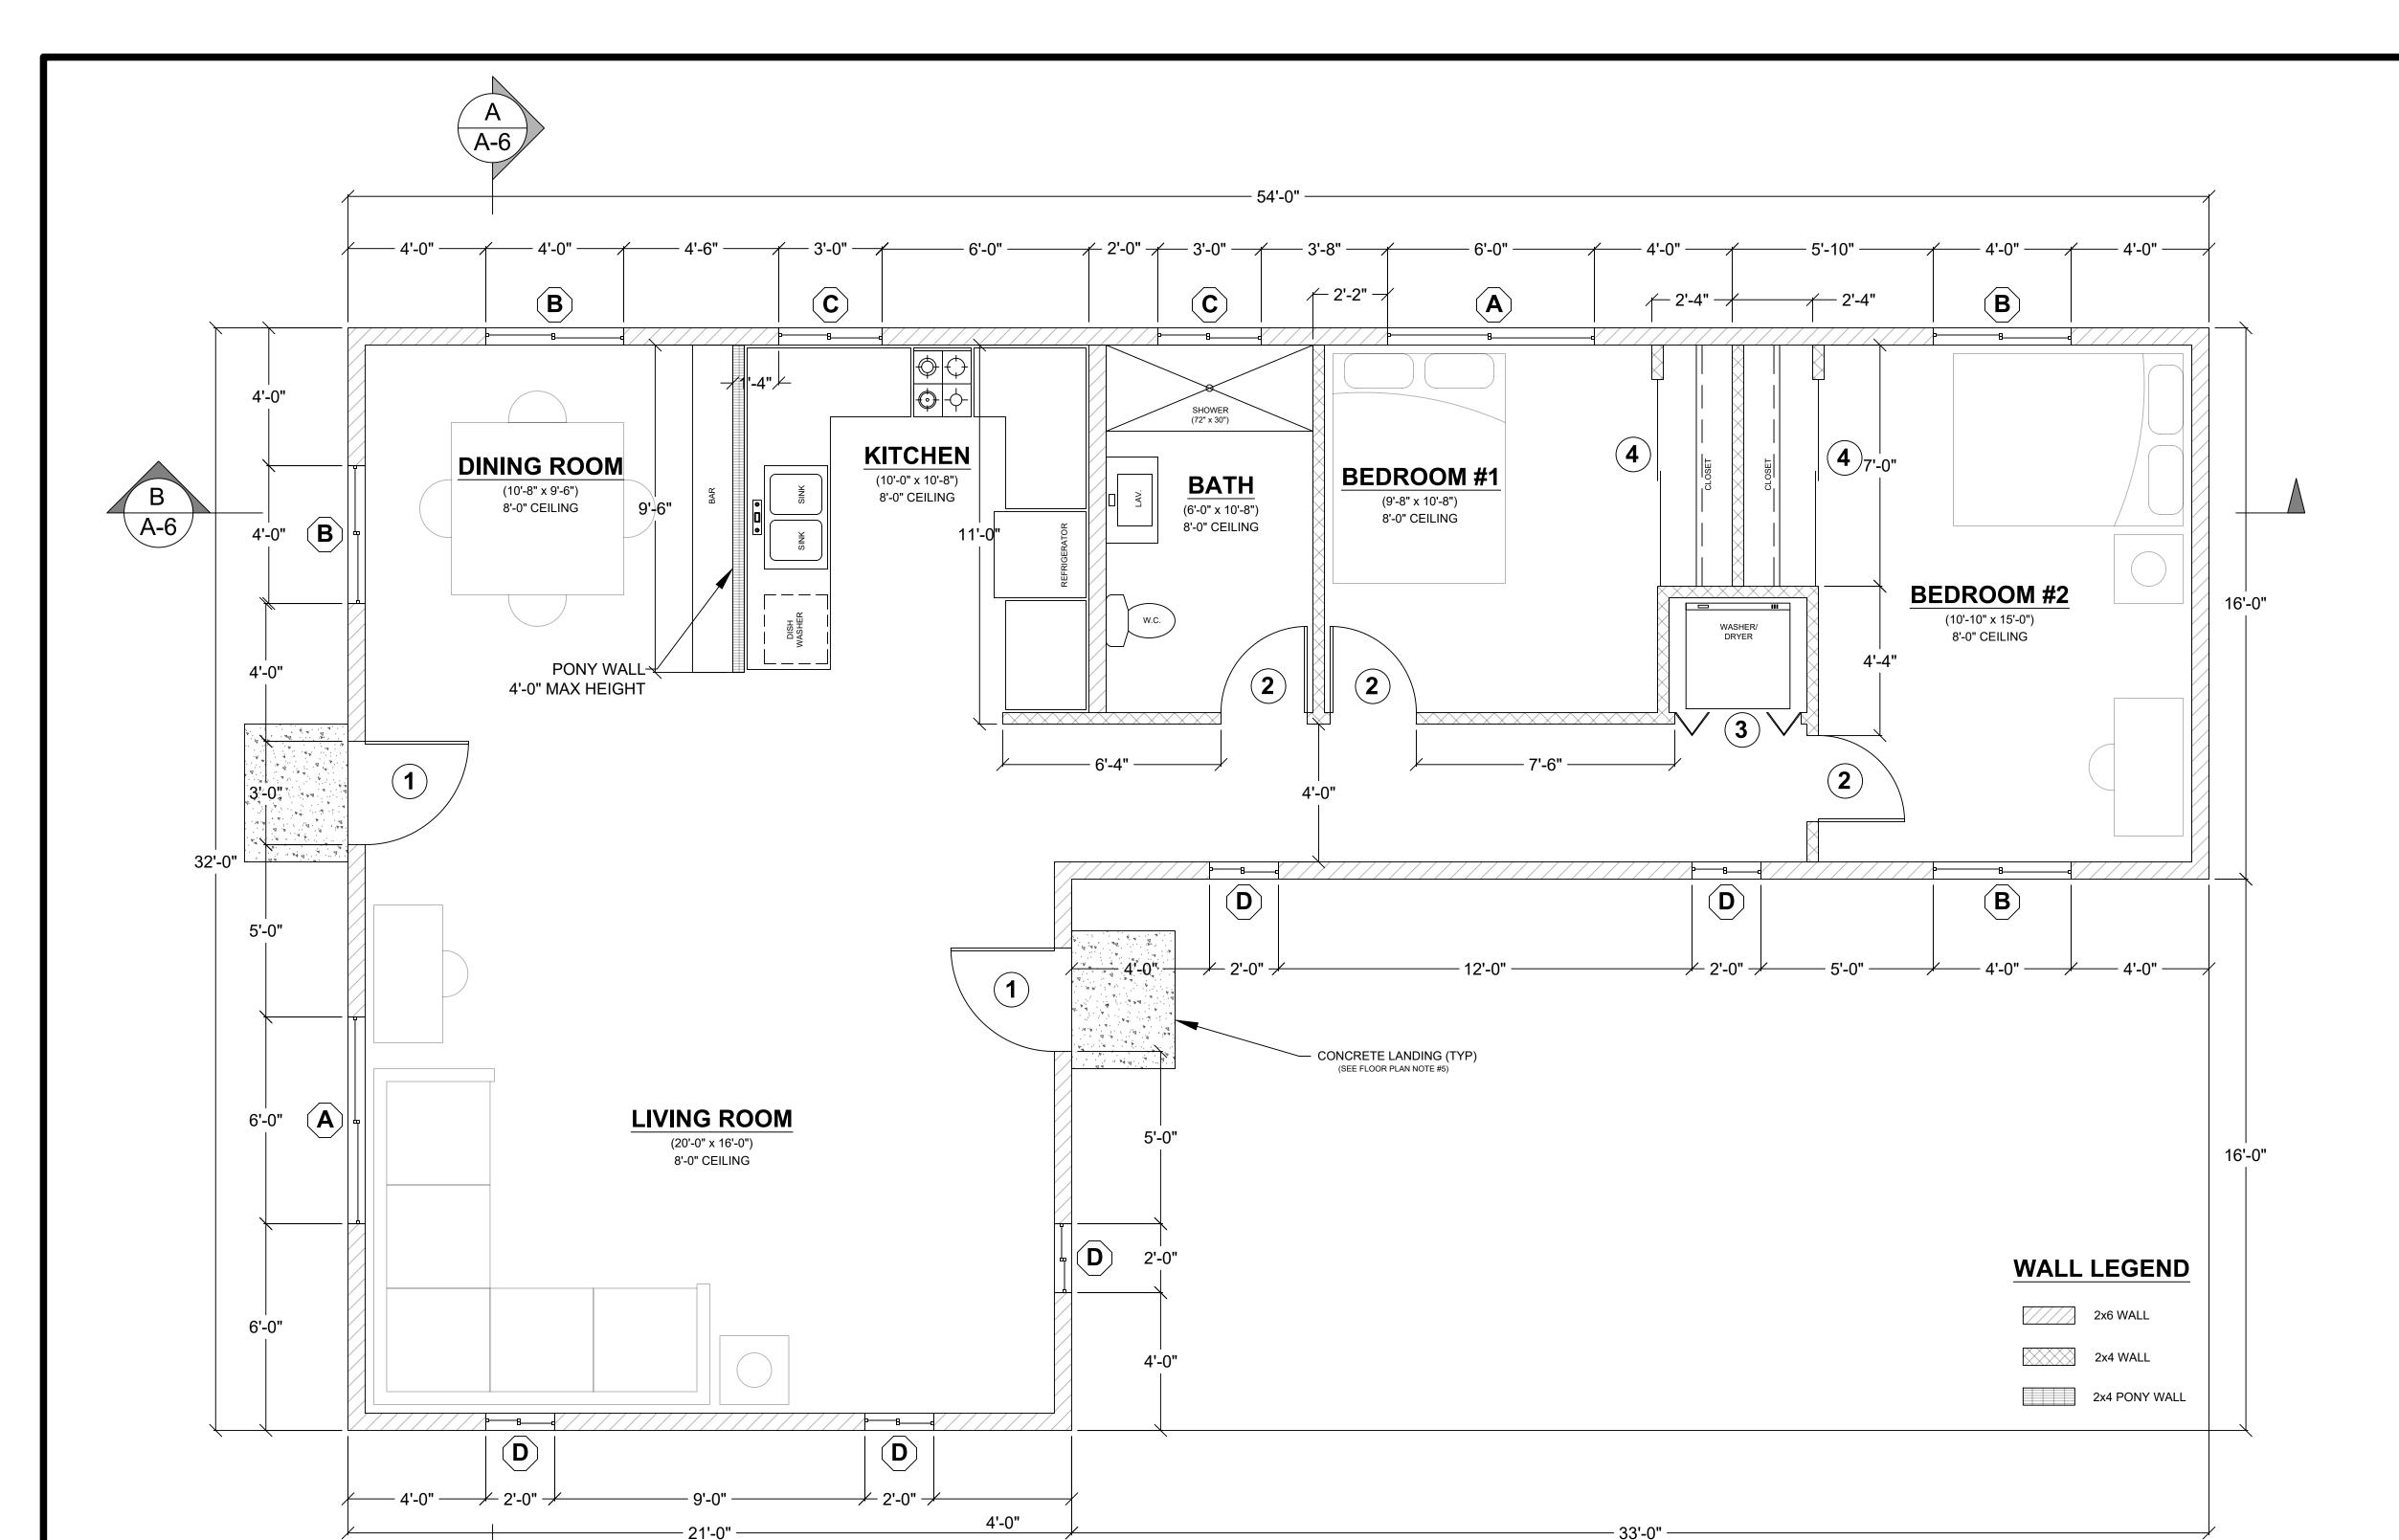

	WINDOW SCHEDULE							
MARK	MARK DIMENSION TYPE TEMPERED NOTES							
(A)	6'-0" x 4'-0"	SLIDING						
(B)	4'-0" x 4'-0"	SLIDING						
C	3'-0" x 2'-0"	SLIDING	Y					
D	2'-0" x 3'-0"	SLIDING						

EXTERIOR WINDOWS, EXTERIOR GLAZED DOORS, GLAZED OPENINGS WITHIN EXTERIOR DOORS, GLAZED OPENINGS WITHIN EXTERIOR GARAGE DOORS, AND EXTERIOR STRUCTURAL GLASS VENEER SHALL COMPLY WITH ONE OF THE FOLLOWING: (SELECT ONE)

- A. MULTI-PANE GLAZING WITH A MINIMUM OF ONE TEMPERED PANE MEETING THE REQUIREMENTS OF SECTION 2406 SAFETY GLAZING, AND WHERE ANY GLAZING FRAMES MADE OF VINYL MATERIALS SHALL HAVE WELDED CORNERS, METAL REINFORCEMENT IN INTERLOCK AREA. AND BE CERTIFIED TO AAMA/WDMA/CSA 101/I.S.2/A40
- MINIMUM 20-MIN FIRE-RESISTANCE-RATED.
- MEET PERFORMANCE REQUIREMENTS OF SFM STANDARD 12-7A-2

DOOR SCHEDULE							
MARK	DIMENSION	TYPE	TEMPERED	NOTES			
1	3'-0" x 6'-8"	SWINGING		1-3/8" SOLID CORE			
(2)	2'-8" x 6'-8"	SWINGING					
3		BI-FOLD		LAUNDRY ROOM			
4	6'-0" x 6'-8"	SLIDING		6FT CLOSET			

EXTERIOR DOORS SHALL COMPLY WITH ONE OF THE FOLLOWING: (SELECT ONE)


- EXTERIOR SURFACE OR CLADDING OF NON-COMBUSTIBLE OR IGNITION-RESISTANT MATERIAL
  - SOLID CORE WOOD COMPLYING WITH THE FOLLOWING:
  - STILES AND RAILS MINIMUM 1-3/8 INCHES THICK

- RAISED PANELS MINIMUM 1-1/4 INCHES THICK
- A TONGUE MINIMUM 3/8 INCHES THICK
- MINIMUM 20-MIN FIRE RATED WHEN TESTED PER NFPA 252
- MEET PERFORMANCE REQUIREMENTS OF SFM STANDARD 12-7A-1

**EXCEPTION:** EXTERIOR PERIMETER OF RAISED PANEL MAY TAPER TO

# | 3/8" = 1'-0" PDS 673 (REV. 10/01/2023)

FLOOR PLAN

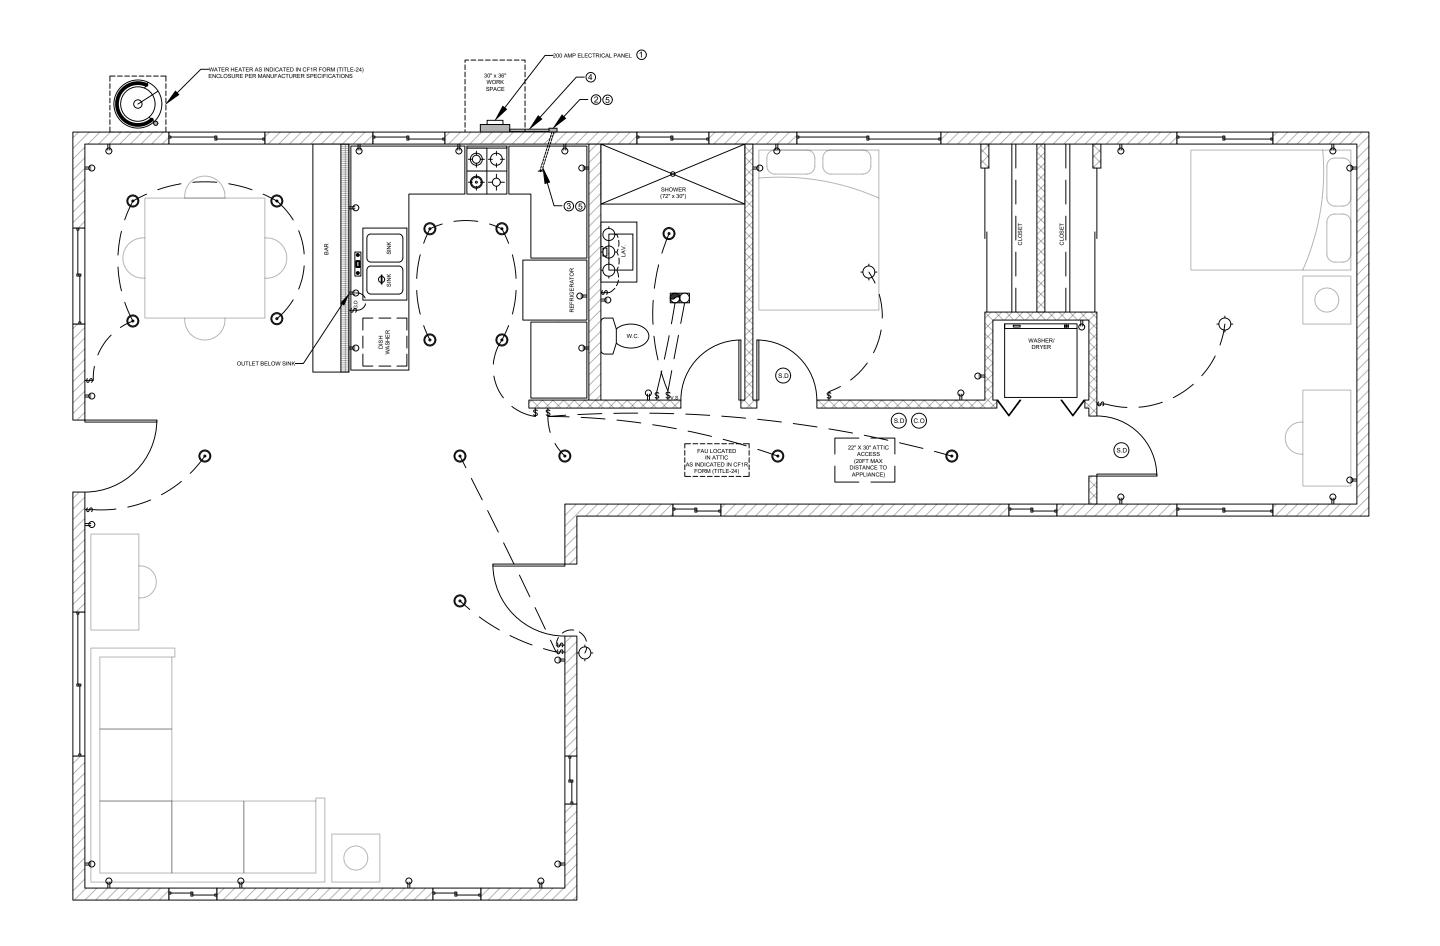

ELECTRICAL LEGEND							
Œ	DUPLEX OUTLET    HIGH EFFICACY RECESSED LIGHT						
\$	WALL SWITCH $\Phi$ GARBAGE DISPOSAL						
$\$_{G.D}$	GARBAGE DISPOSAL SWITCH						
\$ <sub>v.s</sub>	VACANCY SENSOR						
\$	4" DIA DRYER VENT						
(S.D)	SMOKE DETECTOR						
<u>©.</u>	CARBON MONOXIDE ALARM	FAN & LIGHT COMBO					
	FAN AND LIGHT COMBINATION						
$\Diamond$	HIGH EFFICACY LIGHT FIXTURE						

ELECTRICAL PLAN
1/4" = 1'-0"

GAS or PROPANE WATER HEATERS NOTES

SYSTEMS USING GAS OR PROPANE WATER HEATERS TO SERVE INDIVIDUAL DWELLING UNITS SHALL DESIGNATE A SPACE AT LEAST 2.5 FEET BY 2.5 FEET WIDE AND 7 FEET TALL SUITABLE FOR THE FUTURE INSTALLATION OF A HEAT PUMP WATER HEATER (HPWH) BY MEETING EITHER A OR B BELOW. ALL ELECTRICAL COMPONENTS SHALL BE INSTALLED IN ACCORDANCE WITH THE CALIFORNIA ELECTRICAL CODE:

- 1. IF THE DESIGNATED SPACE IS WITHIN 3 FEET FROM THE WATER HEATER, THEN THIS SPACE SHALL INCLUDE THE FOLLOWING:

  a. A DEDICATED 125-VOLT, 20-AMP ELECTRICAL RECEPTACLE THAT IS CONNECTED TO THE ELECTRIC PANEL WITH A 120/240-VOLT 3 CONDUCTOR, 10 AWG COPPER BRANCH CIRCUIT, WITHIN 3 FEET FROM THE WATER HEATER AND ACCESSIBLE TO THE WATER HEATER WITH NO OBSTRUCTIONS: AND
- HEATER WITH NO OBSTRUCTIONS; AND

  b. BOTH ENDS OF THE UNUSED CONDUCTOR SHALL BE LABELED WITH
  THE WORD "SPARE" AND BE ELECTRICALLY ISOLATED; AND

  c. A RESERVED SINGLE POLE CIRCUIT BREAKER SPACE IN THE
  ELECTRICAL PANEL ADJACENT TO THE CIRCUIT BREAKER FOR THE
  BRANCH CIRCUIT IN A ABOVE AND LABELED WITH THE WORDS
- 'FUTURE 240V USE'.

  d. A CONDENSATE DRAIN THAT IS NO MORE THAN 2 INCHES HIGHER THAN THE BASE OF THE INSTALLED WATER HEATER AND ALLOWS NATURAL DRAINING WITHOUT PUMP ASSISTANCE.
- 2. IF THE DESIGNATED SPACE IS MORE THAN 3 FEET FROM THE WATER HEATER, THEN THIS SPACE SHALL INCLUDE THE FOLLOWING:

  a. A DEDICATED 240-VOLT BRANCH CIRCUIT SHALL BE INSTALLED WITHIN 3 FEET FROM THE DESIGNATED SPACE. THE BRANCH CIRCUIT SHALL BE RATED AT 30 AMPS MINIMUM. THE BLANK COVER SHALL BE IDENTIFIED AS "240V READY"; AND
- b. THE MAIN ELECTRICAL SERVICE PANEL SHALL HAVE A RESERVED SPACE TO ALLOW FOR THE INSTALLATION OF A DOUBLE POLE CIRCUIT BREAKER FOR A FUTURE HPWH INSTALLATION. THE RESERVED SPACE SHALL BE PERMANENTLY MARKED AS 'FOR FUTURE 240V USE'; AND
- c. EITHER A DEDICATED COLD—WATER SUPPLY, OR THE COLD—WATER SUPPLY SHALL PASS THROUGH THE DESIGNATED HPWH LOCATION JUST BEFORE REACHING THE GAS OR PROPANE WATER HEATER; AND THE HOLD WATER SUPPLY PIPE COMMON OUT OF THE CAS
- d. THE HOT WATER SUPPLY PIPE COMING OUT OF THE GAS OR PROPANE WATER HEATER SHALL BE ROUTED FIRST THROUGH THE DESIGNATED HPWH LOCATION BEFORE SERVING ANY FIXTURES; AND e. THE HOT AND COLD—WATER PIPING AT THE DESIGNATED HPWH LOCATION SHALL BE EXPOSED AND READILY ACCESSIBLE FOR FUTURE INSTALLATION OF AN HPWH; AND
- f. A CONDENSATE DRAIN THAT IS NO MORE THAN 2 INCHES HIGHER THAN THE BASE OF THE INSTALLED WATER HEATER AND ALLOWS NATURAL DRAINING WITHOUT PUMP ASSISTANCE.

## GAS or PROPANE HEAT PUMPS NOTES

SYSTEMS USING GAS OR PROPANE FURNACE TO SERVE INDIVIDUAL DWELLING UNITS SHALL INCLUDE THE FOLLOWING:

- 1. A DEDICATED 240-VOLT BRANCH CIRCUIT WIRING SHALL BE INSTALLED WITHIN 3 FEET FROM THE FURNACE AND ACCESSIBLE TO THE FURNACE WITH NO OBSTRUCTIONS. THE BRANCH CIRCUIT CONDUCTORS SHALL BE RATED AT 30 AMPS MINIMUM. THE BLANK COVER SHALL BE IDENTIFIED AS '240V READY.' ALL ELECTRICAL COMPONENTS SHALL BE INSTALLED IN ACCORDANCE WITH THE CALIFORNIA ELECTRICAL CODE.
- 2. THE MAIN ELECTRICAL SERVICE PANEL SHALL HAVE A RESERVED SPACE TO ALLOW FOR THE INSTALLATION OF A DOUBLE POLE CIRCUIT BREAKER FOR A FUTURE HEAT PUMP SPACE HEATER INSTALLATION. THE RESERVED SPACE SHALL BE PERMANENTLY MARKED AS 'FOR FUTURE 240V USE.'

# GAS or PROPANE COOKTOPS NOTES

SYSTEMS USING GAS OR PROPANE COOKTOP TO SERVE INDIVIDUAL DWELLING UNITS SHALL INCLUDE THE FOLLOWING:

- 1. A DEDICATED 240-VOLT BRANCH CIRCUIT WIRING SHALL BE INSTALLED WITHIN 3 FEET FROM THE COOKTOP AND ACCESSIBLE TO THE COOKTOP WITH NO OBSTRUCTIONS. THE BRANCH CIRCUIT CONDUCTORS SHALL BE RATED AT 50 AMPS MINIMUM. THE BLANK COVER SHALL BE IDENTIFIED AS '240V READY.' ALL ELECTRICAL COMPONENTS SHALL BE INSTALLED IN ACCORDANCE WITH THE CALIFORNIA ELECTRICAL CODE.
- 2. THE MAIN ELECTRICAL SERVICE PANEL SHALL HAVE A RESERVED SPACE TO ALLOW FOR THE INSTALLATION OF A DOUBLE POLE CIRCUIT BREAKER FOR A FUTURE ELECTRIC COOKTOP INSTALLATION. THE RESERVED SPACE SHALL BE PERMANENTLY MARKED AS 'FOR FUTURE 240V USE.'"

## GAS or PROPANE CLOTHES DRYERS NOTES

CLOTHES DRYER LOCATIONS WITH GAS OR PROPANE PLUMBING TO SERVE INDIVIDUAL DWELLING UNITS SHALL INCLUDE THE FOLLOWING:

- 1. A DEDICATED 240-VOLT BRANCH CIRCUIT WIRING SHALL BE INSTALLED WITHIN 3 FEET FROM THE CLOTHES DRYER LOCATION AND ACCESSIBLE TO THE CLOTHES DRYER LOCATION WITH NO OBSTRUCTIONS. THE BRANCH CIRCUIT CONDUCTORS SHALL BE RATED AT 30 AMPS MINIMUM. THE BLANK COVER SHALL BE IDENTIFIED AS '240V READY.' ALL ELECTRICAL COMPONENTS SHALL BE INSTALLED IN ACCORDANCE WITH THE CALIFORNIA ELECTRICAL CODE.
- 2. THE MAIN ELECTRICAL SERVICE PANEL SHALL HAVE A RESERVED SPACE TO ALLOW FOR THE INSTALLATION OF A DOUBLE POLE CIRCUIT BREAKER FOR A FUTURE ELECTRIC CLOTHES DRYER INSTALLATION. THE RESERVED SPACE SHALL BE PERMANENTLY MARKED AS 'FOR FUTURE 240V USE.'

# UTILITY PLAN NOTES

- 1. LOCAL EXHAUST FANS TO EXTERIOR TO PROVIDE MINIMUM 50 CFM INTERMITTENT OR 20 CFM CONTINUOUS VENTILATION.
- 2. SMOKE DETECTORS TO BE INTERCONNECTED PER CRC R314.4 AND HARD-WIRED WITH BATTERY BACK-UP PER CRC R314.6
- 3. CARBON MONOXIDE ALARMS TO BE INTERCONNECTED PER CRC R315.7
  AND HARD-WIRED WITH BATTERY BACK-UP PER CRC R315.5
- 4. 4" Ø DRYER VENT WITH MAXIMUM 14 FOOT COMBINED HORIZONTAL
- 5. A MECHANICAL EXHAUST VENTILATION SYSTEM, SUPPLY VENTILATION SYSTEM, OR COMBINATION THEREOF SHALL BE INSTALLED FOR EACH DWELLING UNIT TO PROVIDE WHOLE—BUILDING VENTILATION WITH OUTDOOR AIR IN COMPLIANCE WITH ASHRAE STANDARD 62.2 AS

AND VERTICAL LENGTH WITH TWO 90 DEGREE ELBOWS.

ADOPTED BY THE CALIFORNIA ENERGY COMMISSION.

- 6. AN INTERMITTENTLY OR CONTINUOUSLY OPERATING LOCAL MECHANICAL EXHAUST VENTILATION SYSTEM SHALL BE INSTALLED IN EACH BATHROOM WITH A BATHTUB, SHOWER, OR SIMILAR MOISTURE SOURCE AND IN EACH KITCHEN IN COMPLIANCE WITH ASHRAE STANDARD 62.2 AS ADOPTED BY THE CALIFORNIA ENERGY COMMISSION. INTERMITTENT LOCAL EXHAUST VENTILATION AIRFLOW RATES SHALL BE 50 CFM IN BATHROOMS AND 100 CFM IN KITCHENS. CONTINUOUS LOCAL EXHAUST VENTILATION AIRFLOW RATES SHALL BE 20 CFM IN BATHROOMS AND 5 AIR CHANGES PER HOUR IN KITCHENS BASED ON KITCHEN VOLUME.
- 7. WATER HEATER OR FURNACE SHALL BE A DIRECT-VENT APPLIANCE
- 8. LISTED GASKETED SELF-CLOSING DOOR REQUIRED FOR GAS FAU

## LIGHTING PLAN NOTES

- 1. ALL LUMINARIES SHALL BE HIGH-EFFICACY IN ACCORDANCE WITH CBEES TABLE 150.0-A
- 2. ALL LED LUMINARIES AND LAMPS SHALL BE MARKED "JA8" AND LISTED IN THE CALIFORNIA ENERGY COMMISSION DATABASE AT: <a href="https://cacertappliances.energy.ca.gov/pages/appliancesearch.aspx">https://cacertappliances.energy.ca.gov/pages/appliancesearch.aspx</a>
- 3. ALL RECESSED DOWNLIGHT AND ENCLOSED LUMINARIES SHALL BE MARKED "JA8-E" AND LISTED IN THE CALIFORNIA ENERGY COMMISSION DATABASE AT:
- HTTPS://CACERTAPPLIANCES.ENERGY.CA.GOV/PAGES/APPLIANCESEARCH.ASPX

  4. RECESSED DOWNLIGHT LUMINARIES IN CEILINGS SHALL NOT BE SCREW-BASED
- 5. BATHROOMS, GARAGES, LAUNDRY ROOMS, AND UTILITY ROOMS: AT LEAST ONE LUMINARIES IN EACH SPACE SHALL BE CONTROLLED BY A VACANCY SENSOR
- 6. ALL LUMINARIES REQUIRING "JA8" OR "JA8—E" MARKING SHALL BE CONTROLLED BY A DIMMER OR VACANCY SENSOR EXCEPTION: CLOSETS LESS THAN 70 S.F. & HALLWAYS
- 7. OUTDOOR LIGHTING PERMANENTLY MOUNTED TO BUILDINGS SHALL BE CONTROLLED BY ONE OF THE FOLLOWING:
- PHOTOCONTROL AND MOTION SENSORPHOTOCONTROL AND AUTOMATIC TIME—SWITCH CONTROL
- ASTRONOMICAL TIME CLOCK
  ENERGY MANAGEMENT CONTROL SYSTEM PER CBEES 150.0(K)3AIIIC

# ENERGY STORAGE SYSTEMS (ESS) NOTES

- 1. AT LEAST ONE OF THE FOLLOWING SHALL BE PROVIDED:

  a. ESS READY INTERCONNECTION EQUIPMENT WITH A MINIMUM BACKED—UP CAPACITY OF 60 AMPS AND A MINIMUM OF FOUR
- ESS—SUPPLIED BRANCH CIRCUITS, OR

  b. A DEDICATED RACEWAY FROM THE MAIN SERVICE TO A PANELBOARD (SUBPANEL) THAT SUPPLIES THE BRANCH CIRCUITS IN SECTION 150.0(S)(2). ALL BRANCH CIRCUITS ARE PERMITTED TO BE SUPPLIED BY THE MAIN SERVICE PANEL PRIOR TO THE INSTALLATION OF AN ESS. THE TRADE SIZE OF THE RACEWAY SHALL BE NOT LESS THAN ONE INCH. THE PANELBOARD THAT SUPPLIES THE BRANCH CIRCUITS (SUBPANEL) MUST BE LABELED "SUBPANEL SHALL INCLUDE ALL BACKED—UP LOAD CIRCUITS."
- 2. A MINIMUM OF FOUR BRANCH CIRCUITS SHALL BE IDENTIFIED AND HAVE THEIR SOURCE OF SUPPLY COLLOCATED AT A SINGLE PANELBOARD SUITABLE TO BE SUPPLIED BY THE ESS. AT LEAST ONE CIRCUIT SHALL SUPPLY THE REFRIGERATOR, ONE LIGHTING CIRCUIT SHALL BE LOCATED NEAR THE PRIMARY EGRESS, AND AT LEAST ONE CIRCUIT SHALL SUPPLY A SLEEPING ROOM RECEPTACLE OUTLET.
- 3. THE MAIN PANELBOARD SHALL HAVE A MINIMUM BUSBAR RATING OF 225 AMPS.
- 4. SUFFICIENT SPACE SHALL BE RESERVED TO ALLOW FUTURE INSTALLATION OF A SYSTEM ISOLATION EQUIPMENT/TRANSFER SWITCH WITHIN 3 FEET OF THE MAIN PANELBOARD. RACEWAYS SHALL BE INSTALLED BETWEEN THE PANELBOARD AND THE SYSTEM ISOLATION EQUIPMENT/TRANSFER SWITCH LOCATION TO ALLOW THE CONNECTION OF BACKUP POWER SOURCE.

# SOLAR READY KEY NOTES

- 1. THE MAIN ELECTRICAL SERVICE PANEL SHALL NOT BE OF A TYPE WITH A CENTER-FED MAIN CIRCUIT BREAKER AND SHALL INCLUDE RESERVED SPACE ALLOWING FOR INSTALLATION OF DOUBLE-POLE CIRCUIT BREAKERS FOR A FUTURE SOLAR PHOTOVOLTAIC SYSTEM. SUCH RESERVED SPACE SHALL BE POSITIONED AT THE OPPOSITE (LOAD) END FROM THE INPUT FEEDER OR MAIN CIRCUIT BREAKER LOCATION. THE RESERVED SPACE SHALL BE PERMANENTLY AND VISIBLY MARKED AS "FOR FUTURE SOLAR PHOTOVOLTAIC"
- 2. APPROVED MINIMUM 4-INCH SQUARE ELECTRICAL JUNCTION BOX LOCATED WITHIN 72 INCHES HORIZONTALLY AND 12 INCHES VERTICALLY OF MAIN ELECTRICAL SERVICE PANEL
- 3. MINIMUM 1 INCH DIAMETER LISTED ELECTRICAL METALLIC RACEWAY ORIGINATING AT READILY ACCESSIBLE ATTIC LOCATION WITH PROXIMITY TO SOLAR ZONE AREA AND TERMINATING AT THE REQUIRED ELECTRICAL JUNCTION BOX
- 4. MINIMUM 1 INCH DIAMETER LISTED ELECTRICAL METALLIC RACEWAY ORIGINATING AT THE REQUIRED ELECTRICAL JUNCTION BOX AND TERMINATING AT THE MAIN ELECTRICAL SERVICE PANEL
- 5. ELECTRICAL JUNCTION BOX AND SEGMENT OF METALLIC RACEWAY IN THE ATTIC SHALL BE PERMANENTLY AND VISIBLY MARKED AS "FOR FUTURE SOLAR PHOTOVOLTAIC"

By using these standard plans, the user agrees to release the County of San Diego fror and all claims, liabilities, suits, and demands on account of any injury, damage, or loss persons or property, including injury or death, or economic losses, arising out of the use these construction documents. The use of these plans does not eliminate or reduce the


elopm 0 20 ~ O  $\Box$ ∞ 5 lanning 1 NO! Diego, NG UI an DING of ounty C



Sheet Number

**A2** 

# **FRONT**

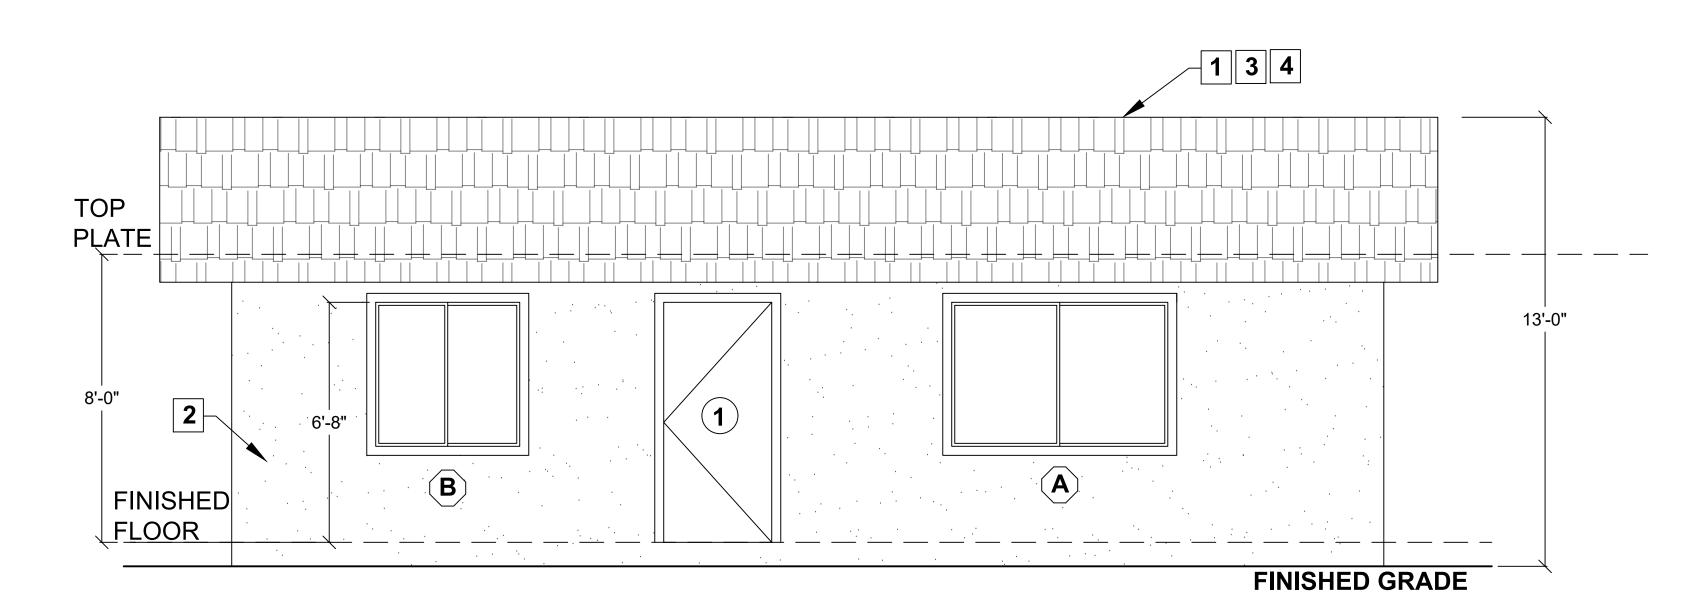

# BACK

ELEVATIONS 3/8" = 1'-0" **ELEVATION KEY NOTES** 

1. ROOF: CLASS 'A' FIRE RATING

ROOF MATERIAL:

MANUFACTURER / MODEL:

UNDERLAYMENT:

LISTING REPORT #:

2. EXTERIOR WALL FINISH: \_\_\_\_\_\_ (SEE NOTE 7 BELOW)

3. ROOF PITCH: \_\_\_\_\_\_

4. RADIANT BARRIER IS REQUIRED YES | NO |

## WILDFIRE ZONE PLAN NOTES

- 1. IN ROOF COVERINGS WHERE THE PROFILE CREATES SPACE BETWEEN THE ROOF COVERING AND COMBUSTIBLE ROOF DECKING, SPECIFY ONE OF THE FOLLOWING MEANS OF PROTECTING SPACES AT EAVES ENDS:

  a. FIRE—STOPPING WITH APPROVED MATERIALS
- b. ONE LAYER OF 72 POUND (32.4 KG) MINERAL-SURFACED NON-PERFORATED CAP SHEET COMPLYING WITH ASTM D 3909 INSTALLED OVER THE COMBUSTIBLE DECKING

  c. OTHERWISE CONSTRUCTED TO PREVENT INTRUSION OF FLAMES AND
- 2. EXPOSED VALLEY FLASHINGS SHALL BE CONSTRUCTED WITH NOT LESS THAN 0.019-INCH (NO. 26 GALVANIZED SHEET GAGE) CORROSION-RESISTANT METAL INSTALLED OVER A MINIMUM 36-INCH-WIDE UNDERLAYMENT CONSISTING OF ONE LAYER OF NO. 72 ASTM CAP SHEET RUNNING THE FULL LENGTH OF THE VALLEY.
- 3. ANY ROOF GUTTERS SHALL BE PROVIDED WITH MEANS TO PREVENT ACCUMULATION OF LEAVES AND DEBRIS.
- 4. SKYLIGHTS SHALL BE TEMPERED GLASS.
- 5. ALL VENTS (ROOF, FOUNDATION, COMBUSTION—AIR, ETC) SHALL RESIST THE INTRUSION OF FLAMES AND EMBERS
- 6. VENTILATION OPENINGS FOR ENCLOSED ATTICS, EAVE SOFFIT SPACES, ENCLOSED RAFTER SPACES FORMED WHERE CEILINGS ARE APPLIED DIRECTLY TO THE UNDERSIDE OF ROOF RAFTERS, UNDERFLOOR VENTILATION OPENINGS, AND VENT OPENINGS IN EXTERIOR WALLS AND EXTERIOR DOORS SHALL BE LISTED TO ASTM E 2886 AND COMPLY WITH ALL OF THE FOLLOWING:
- a. THERE SHALL BE NO FLAMING IGNITION OF THE COTTON MATERIAL DURING THE EMBER INTRUSION TEST
  b. THERE SHALL BE NO FLAMING IGNITION DURING THE INTEGRITY TEST
- PORTION OF THE FLAME INTRUSION TEST

  c. THE MAXIMUM TEMPERATURE OF THE UNEXPOSED SIDE OF THE VENT SHALL NOT EXCEED 662 DEGREES FAHRENHEIT (350 DEGREES CELSIUS)
- 7. EXTERIOR WALL FINISH SHALL COMPLY WITH ONE OF THE FOLLOWING:
  a. NON-COMBUSTIBLE MATERIAL (STUCCO, CEMENT FIBER BOARD, ETC)
   STUCCO AND CEMENT PLASTER USED AS AN EXTERIOR WALL
  - COVERING SHALL BE 7/8-INCH THICK

     NONCOMBUSTIBLE OR FIRE-RETARDANT-TREATED WOOD SHAKE USED AS AN EXTERIOR WALL COVERING SHALL HAVE AN UNDERLAYMENT OF MINIMUM 1/2-INCH FIRE-RATED GYPSUM SHEATHING THAT IS TIGHTLY BUTTED, OR TAPED AND MUDDED, OR AN UNDERLAYMENT OF OTHER IGNITION-RESISTANT MATERIAL APPROVED BY THE BUILDING OFFICIAL.
- b. IGNITION-RESISTANT MATERIAL
- 8. PATIO COVER, CARPORT AND TRELLIS CONSTRUCTION WITH ALL EXPOSED ELEMENTS SHALL COMPLY WITH ANY OF THE FOLLOWING:
  - NON-COMBUSTIBLE MATERIAL1-HOUR FIRE-RESISTANT-RATED MATERIAL
  - APPROVED EXTERIOR FIRE—RETARDANT TREATED WOOD
     MODIFIED HEAVY TIMBER (MIN 2X TONGUE—AND—GROOVE SHEATHING, 4X6 RAFTERS/BEAMS, 6X6 POSTS)
- 9. DECK, BALCONY, AND EXTERIOR STAIR CONSTRUCTION, WITH ALL EXPOSED ELEMENTS SHALL COMPLY WITH THE FOLLOWING:

  a. FRAMING
- NON-COMBUSTIBLE MATERIAL
- 1—HOUR FIRE—RESISTANT—RATED MATERIALAPPROVED EXTERIOR FIRE—RETARDANT TREATED WOOD
- MODIFIED HEAVY TIMBER (MIN 4X8 JOISTS, 4X10 OR 6X8 BEAMS, 6X6 POSTS)
- b. DECKING AND TREAD MATERIAL (ANY OF THE FOLLOWING):
- NON-COMBUSTIBLE MATERIAL
- 1-HOUR FIRE-RESISTANT-RATED MATERIALAPPROVED EXTERIOR FIRE-RETARDANT TREATED WOOD
- APPROVED ALTERNATIVE DECKING MATERIAL MEETING TESTS REQUIREMENTS OF COUNTY BUILDING CODE 92.1.709A.1.4)
- 10. EXTERIOR GARAGE DOORS SHALL RESIST THE INTRUSION OF EMBERS INTO THE GARAGE BY LIMITING THE SIZE OF ANY GAPS AT THE BOTTOM, SIDES, AND TOP OF THE DOOR TO 1/8 INCH OR LESS USING ONE OF THE FOLLOWING METHODS:
- a. WEATHER—STRIPPING PRODUCTS WITH TENSILE STRENGTH AND FLAMMABILITY RATING PER CBC 708A.4
  b. DOOR OVERLAPS ONTO JAMBS AND HEADERS
- c. GARAGE DOOR JAMBS AND HEADERS COVERED WITH METAL FLASHING
- 11. PAPER—FACED INSULATION PROHIBITED IN ATTICS OR OTHER VENTILATED SPACES.
- 12. FENCES OR ANY STRUCTURE WITHIN 5 FEET OF BUILDING SHALL BE CONSTRUCTED PER ONE OF THE FOLLOWING:

  a. NON-COMBUSTIBLE MATERIAL
- b. APPROVED EXTERIOR FIRE—RETARDANT TREATED WOOD
- c. MATERIAL MEETING SAME FIRE—RESISTIVE STANDARDS AS EXTERIOR WALLS OF BUILDINGS

San Diego, Planning & Development Services and all claims, liabilities ING UNIT (PLAN B - 1200 SF)

Spersons or property, inc these construction documents and all claims, liabilities persons or property, inc these construction documents.

r agrees to nands on a death, or e of these

Sheet Number

DING

County DWEL BUILDI

of

PDS 673 (REV. 10/01/2023)

**A3** 

TOP PLATE 8'-0" FINISHED FLOOR FINISHED GRADE RIGHT 1 3 4 TOP PLATE B FINISHED FLOOR FINISHED GRADE LEFT

**ELEVATION KEY NOTES** 

SEE SHEET A3 FOR KEYNOTES

By using these standard plans, the user agrees to release the County of San Diego from an and all claims, liabilities, suits, and demands on account of any injury, damage, or loss to persons or property, including injury or death, or economic losses, arising out of the use of these construction documents. The use of these plans does not eliminate or reduce the use responsibility to verify any and all information.

County of San Diego, Planning & Development Services

DWELLING UNIT (PLAN B - 1200 SF)

BUILDING DIVISION




Sheet Number

**A4** 

3/8" = 1'-0"

ELEVATIONS

# 123 274SF DEDICATED SOLAR **ZONE AREA** (AREA A) (1)(2)(3)274 SF DEDICATED SOLAR ZONE AREA (AREA B) 324 SF DEDICATED SOLAR ZONE AREA (AREA C)

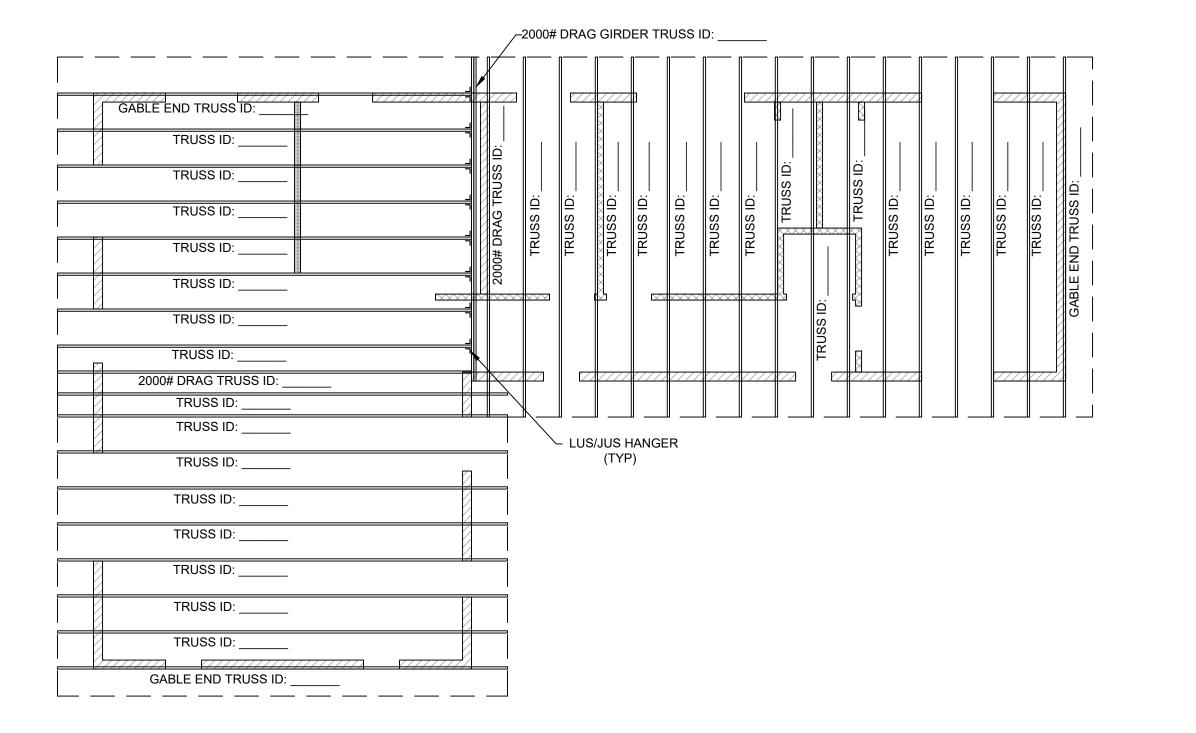

# SOLAR READY KEY NOTES (

WHEN PV SYSTEM NOT REQUIRED PER ENERGY COMPLIANCE DOCUMENTATION OR OTHERWISE EXEMPTED:

- 1. MIN 250 S.F. SOLAR ZONE AREA
- 2. DEDICATED SOLAR ZONE AREA LOCATED BETWEEN 110 AND 270 DEGREES OF TRUE NORTH - USE AREA A OR B AS NEEDED.
- 3. NO OBSTRUCTIONS INCLUDING VENTS, CHIMNEYS, SKYLIGHTS, ARCHITECTURAL FEATURES, ROOF—MOUNTED EQUIPMENT LOCATED WITHIN SOLAR ZONE.
- 4. 3' MIN FIRE FIGHTER ACCESS
- 5. 3' SMOKE VENTILATION SETBACK AT RIDGES

# ATTIC VENTILATION

ATTIC VENTILATION REQUIRED (SEE WILDFIRE NOTES 5 & 6 ON SHEET A3)

NET FREE CROSS VENTILATION AREA =  $\frac{1}{300}$ 

1. GABLE VENT (MIN ONE VENT AT EACH GABLE END)

VENT AREA REQUIRED = 1200 ft $^2$ / 300 = 4 ft $^2$  x 144 =  $\frac{576 \text{ in}^2}{\text{TOTAL VENT}}$  AREA PROMDED

MANUFACTURER:\_\_\_\_\_

QTY: \_\_\_\_\_\_ in<sup>2</sup> VENT AREA PROVIDED = QTY x NFVA = \_\_\_\_\_ in<sup>2</sup> 2. EAVE VENT

VENT AREA PROVIDED =  $\underline{QTY} \times \underline{NFVA} = \underline{\qquad}$  in<sup>2</sup>

3. ROOF VENT MANUFACTURER:\_\_\_\_\_ VENT AREA PROVIDED = QTY x NFVA = \_\_\_\_\_ in<sup>2</sup>

4. INSTALL BETWEEN 40% AND 50% OF THE REQUIRED NET FREE VENT AREA A MAXIMUM OF 3 FEET BELOW THE RIDGE OR THE HIGHEST POINT OF THE SPACE (MEASURED VERTICALLY), AND INSTALL THE BALANCE OF THE REQUIRED VENTILATION IN THE BOTTOM ONE-THIRD OF THE ATTIC SPACE.

Development (3 - 1200 SF) Planning (PLAN County of San Diego, P


DWELLING UNIT

BUILDING DIVISION

Sheet Number

ROOF PLAN / TRUSS LAYOUT 3/16" = 1'-0"

PDS 673 (REV. 10/01/2023)

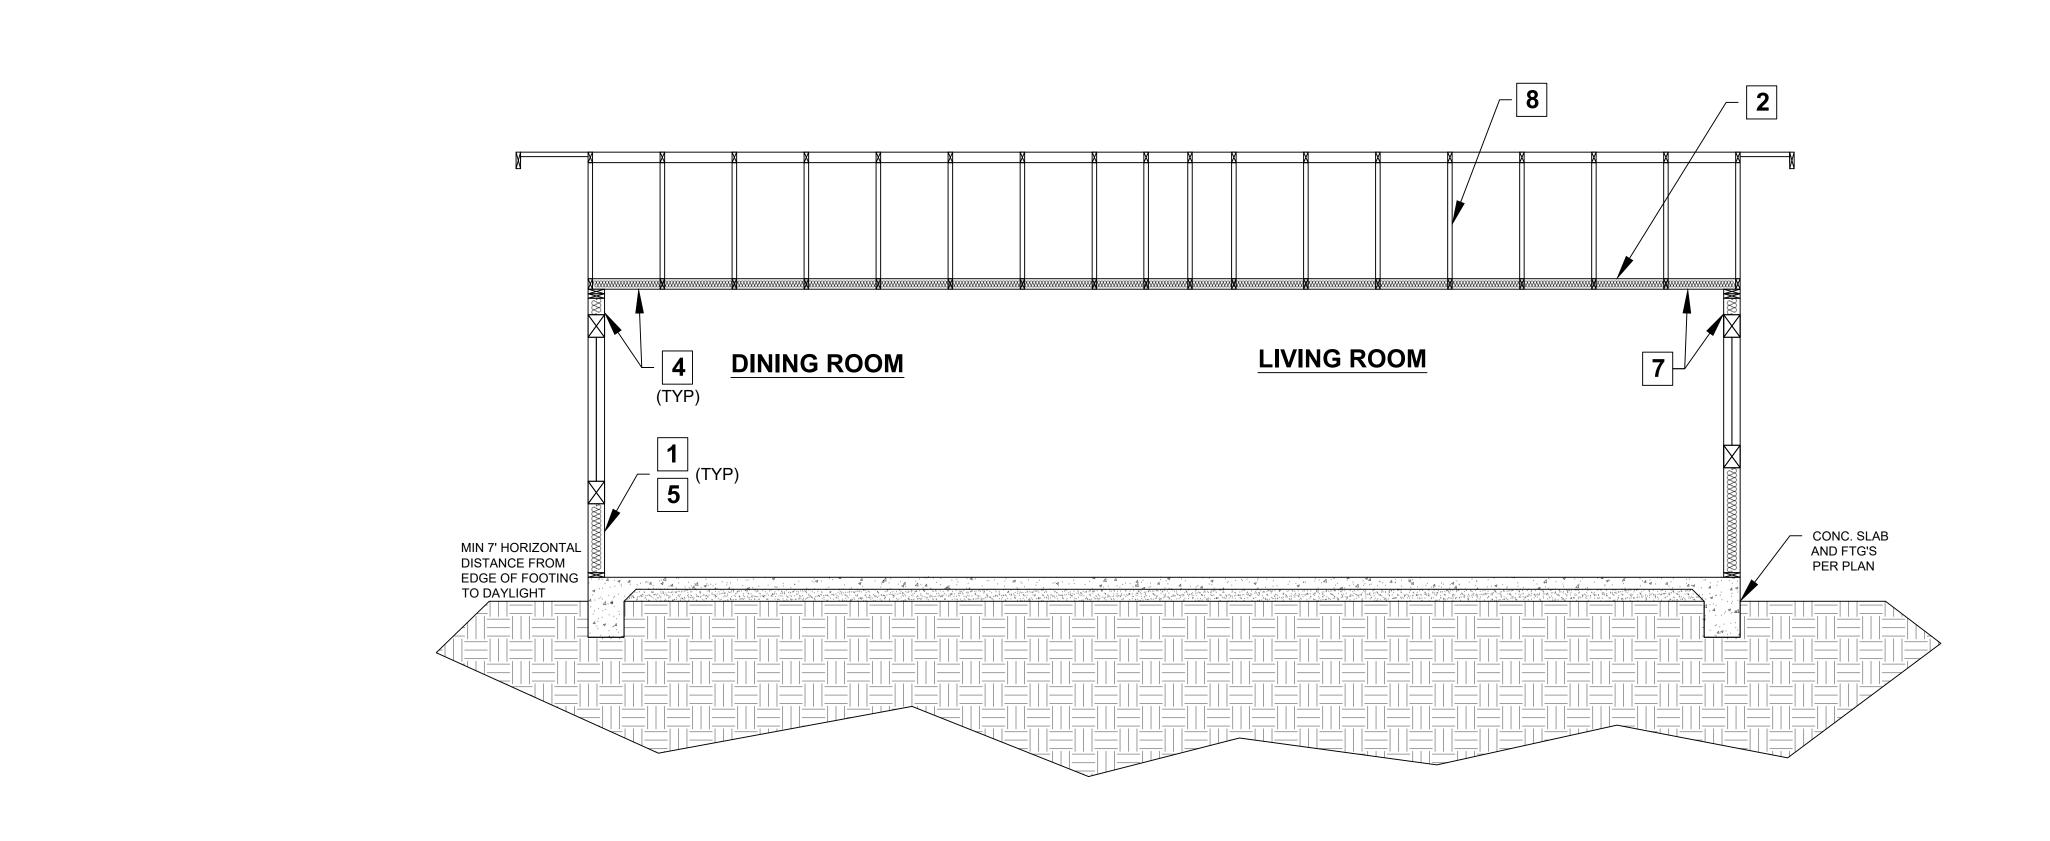

**KITCHEN** 

(TYP)

# SECTION KEY NOTES

- 1. WALL INSULATION:
- 2. CEILING INSULATION: \_
- 3. ROOF (TOP CHORD) INSULATION:
- 4. INTERIOR FINISH:  $\frac{1}{2}$  GYPSUM BOARD
- 5. EXTERIOR WALL/PLUMBING WALL: 2X6 STUD WALL
- 6. INTERIOR WALL: 2X4 STUD WALL
- 7. CLIMATE ZONE 14 PROJECT (Y or N) if yes, see below: A CLASS I OR II VAPOR RETARDER SHALL BE INSTALLED ON THE CONDITIONED SPACE SIDE OF ALL INSULATION IN ALL EXTERIOR
- 8. MANUFACTURED TRUSSES

WALLS AND VENTED ATTICS

Development Services - 1200 SF)


Planning (

County of San Diego, F

DWELLING UNIT

BUILDING DIVISION

**IGNITION-RESISTANT EAVE** 

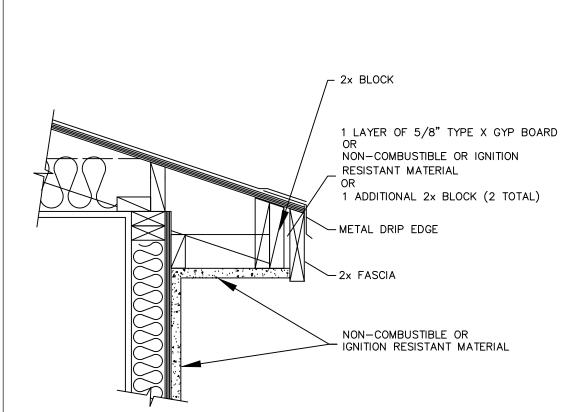

SECTION B-B

**BEDROOM** 

**BEDROOM** 

CONC. SLAB
AND FTG'S
PER PLAN

**BATH** 

SECTION A-A

SECTIONS 3/8" = 1'-0"

MIN 7' HORIZONTAL DISTANCE FROM

EDGE OF FOOTING TO DAYLIGHT

\_\_ "DETAIL 1"

**DINING ROOM** 

Sheet Number

PDS 673 (REV. 10/01/2023)

			WOOD STE	DIICTIIDAI DANI	EL SHEATHING		
MARK	MINIMUM NAIL		MINIMUM WOOD STRUCTURAL PANEL SPAN	MINIMUM NOMINAL PANEL THICKNESS	MAXIMUM WALL STUD SPACING (in)	PANEL NAIL SPACING	
	SIZE	PENETRATION (in)	RATING	(in)		EDGES (inches o/c)	FIELD (inches o/c
	6D COMMON	1.5	24:0	<u>3</u> " 8	16	6	12
	8D COMMON	1.75	24:16	<u>7</u> " 16	16	6	12

WOOD STRUCTURAL PANELS SHALL CONFORM TO DOC PS 1, DOC PS 2 OR ANSI/APA PRP 210, CSA O437 OR CSA O325. PANELS SHALL BE IDENTIFIED BY A GRADE MARK OR CERTIFICATE OF INSPECTION ISSUED BY AN APPROVED AGENCY

<u>4'-0"</u>


<u>/1\</u> 8'-0"

4'-0"

VERTICAL JOINTS OF PANEL SHEATHING SHALL OCCUR OVER AND BE FASTENED TO COMMON STUDS. HORIZONTAL JOINTS IN BRACED WALL PANELS SHALL OCCUR OVER AND BE FASTENED TO COMMON BLOCKING OF A MINIMUM 1  $\frac{1}{2}$  INCH THICKNESS.

# FOUNDATION PLAN


1/4" = 1'-0"

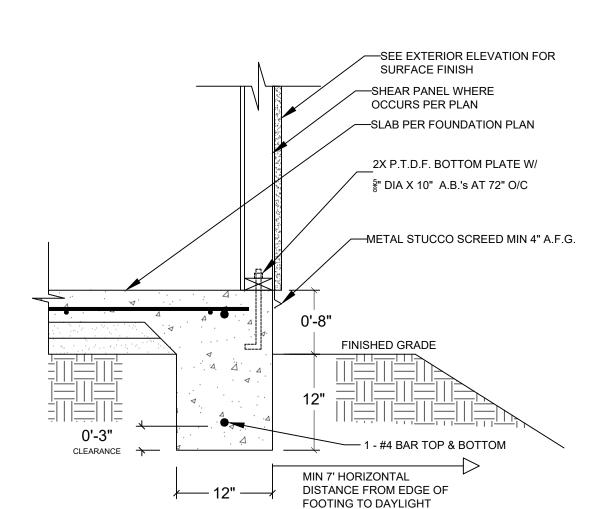

# 1 <u>EXTERIOR FOOTING</u>

2

2x4 PONY WALL

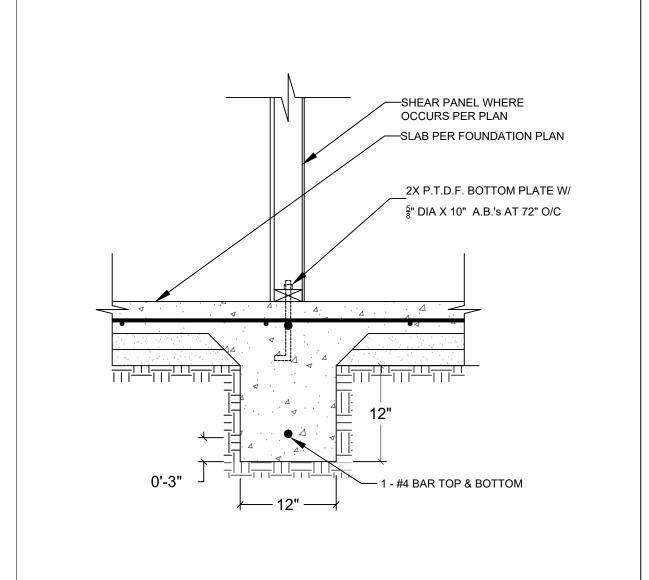

**INTERIOR FOOTING** 

# FOUNDATION PLAN NOTES

- 1. ALL ANCHORS BOLTS SHALL BE 5/8" DIAMETER AND HAVE A MINIMUM EMBEDMENT OF 7 INCHES INTO CONCRETE (UNO) AND NOT SPACED MORE THAN 6 FEET APART
- 2. 3"X3"X0.229" PLATE WASHERS SHALL BE USED ON EACH SILL PLATE ANCHOR BOLT
- 3. FOR STANDARD CUT WASHERS PLACED BETWEEN PLATE WASHER AND NUT, HOLE IN PLATE WASHER MAY BE DIAGONALLY SLOTTED WITH MAXIMUM  $\frac{3}{16}$ " LARGER WIDTH THAN BOLT DIAMETER AND MAXIMUM  $1-\frac{3}{4}$ " SLOT LENGTH
- 4. PROVIDE A MINIMUM OF TWO ANCHOR BOLTS PER SILL PLATE WITH ONE BOLT LOCATED MAXIMUM 12" AND MINIMUM 7 BOLT DIAMETERS FROM EACH END OF EACH SECTION.
- 5. BOLTS LOCATED IN THE MIDDLE THIRD OF THE SILL PLATE WIDTH
- 6. FASTENERS FOR PRESSURE—PRESERVATIVE TREATED AND FIRE RETARDANT TREATED WOOD SHALL BE HOT—DIPPED ZINC COATED GALVANIZED, STAINLESS STEEL OR COPPER
- . NO LPG PIPING ASSEMBLIES ALLOWED IN OR BENEATH SLABS WITHIN THE STRUCTURE

By using these standard plans, the user agrees to release the County of San Diego from a and all claims, liabilities, suits, and demands on account of any injury, damage, or loss to persons or property, including injury or death, or economic losses, arising out of the use or these construction documents. The use of these plans does not eliminate or reduce the use responsibility to verify any and all information.

County of San Diego, Planning & Development Service DWELLING UNIT (PLAN B - 1200 SF)


BUILDING DIVISION



Sheet Number

**S1** 

PDS 673 (REV. 10/01/2023)

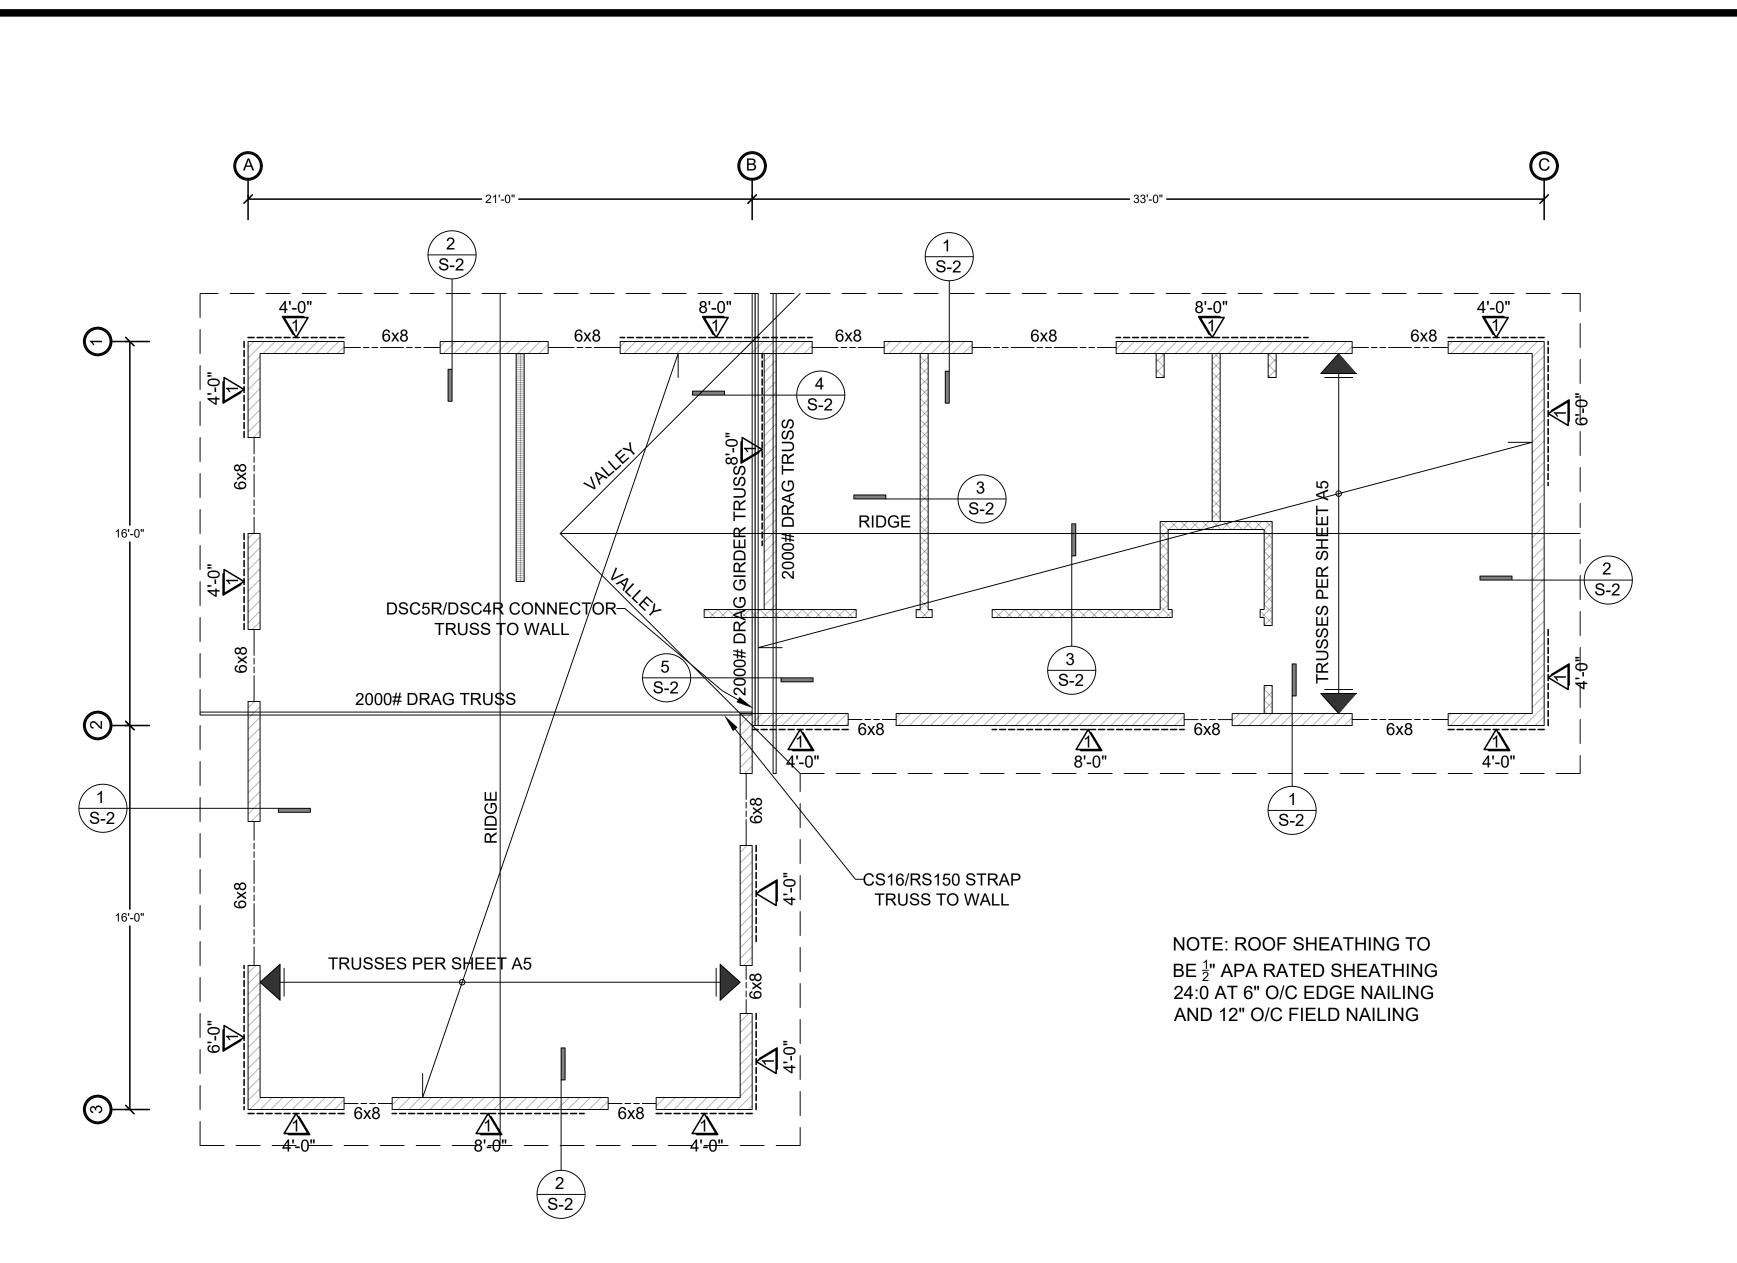

	WOOD STRUCTURAL PANEL SHEATHING									
MARK	MINIMUM NAIL		PANEL SPAN PANEL THICKNES	MINIMUM NOMINAL PANEL THICKNESS	MAXIMUM WALL STUD SPACING (in)	PANEL NAIL SPACING				
	SIZE	PENETRATION (in)	RATING	(in)		EDGES (inches o/c)	FIELD (inches o/c)			
1	6D COMMON	1.5	24:0	<u>3</u> " 8	16	6	12			
	8D COMMON	1.75	24:16	<u>7</u> " 16	16	6	12			

WOOD STRUCTURAL PANELS SHALL CONFORM TO DOC PS 1, DOC PS 2 OR ANSI/APA PRP 210, CSA O437 OR CSA O325. PANELS SHALL BE IDENTIFIED BY A GRADE MARK OR CERTIFICATE OF INSPECTION ISSUED BY AN APPROVED AGENCY

VERTICAL JOINTS OF PANEL SHEATHING SHALL OCCUR OVER AND BE FASTENED TO COMMON STUDS. HORIZONTAL JOINTS IN BRACED WALL PANELS SHALL OCCUR OVER AND BE FASTENED TO COMMON BLOCKING OF A MINIMUM 1  $\frac{1}{2}$  INCH THICKNESS.

# —2X TRUSSES PER ROOF FRAMING PLAN -ADDITIONAL 2X TRUSS SEE SHEET A6 "DETAIL 1" FOR-DIRECTLY ABOVE FIRE RESISTANT EAVE BRACED WALL PANEL PLY SHEATHING CONSTRUCTION PER ROOF FRAMING PLAN —BOUNDARY NAILING A-35/MPA1 AT 24" O/C U.N.O-----EDGE NAILING —2X DOUBLE TOP PLATE WITH 48" MIN LAP BRACED WALL PANEL -2X DOUBLE TOP PLATE WITH 48" MIN LAP - 2X P.T.D.F. **BOTTOM PLATE** OCCURS PER PLAN BRACED WALL PANEL PARALLEL TO EAVE (SHEAR TRANSFER) **CEILING FRAMING** SEE SHEET A6 "DETAIL 1" -—PLY SHEATHING PER ROOF FRAMING PLAN FOR FIRE RESISTANT EAVE NOTE: GIRDER TRUSS OMITTED FOR CLARITY CONSTRUCTION -EDGE NAILING DRAG TRUSS-PER ROOF FRAMING PLAN E.N. TO DRAG TRUSS ——CS16/RS150 STRAP —GABLE END TRUSS ROOF FRAMING PLAN ├─ MIN 24" LAP -—2X BLKG W/ Z CLIPS @ 24" O/C (TYP) —A-35/MPA1 AT 24" O/C U.N.O ---DOUBLE TOP PLATE —EDGE NAILING —2X DOUBLE TOP PLATE WITH 48" MIN LAP WHERE OCCURS PER PLAN (5)GABLE-END (SHEAR TRANSFER) DRAG TRUSS CONNECTION —2X TRUSSES PER ROOF FRAMING PLAN FULL HEIGHT-STUDS ADJACENT TO HEADER – SINGLE OR DOUBLE TOP PLATE -SIMPSON STC ROOF TRUSS CLIP – HEADER TRUSS PERPENDICULAR TO FRAMING MEMBER JACK STUDS/ TRIMMERS —2X TRUSSES PER ROOF FRAMING PLAN -SIMPSON STC ROOF TRUSS CLIP - CRIPPLE

BOTTOM— PLATE

(6)

TYPICAL FRAMING AT OPENING

TRUSS PARALLEL TO FRAMING MEMBER

NON-BEARING WALL

3

**ROOF FRAMING PLAN** 

1/4" = 1'-0"

**Sheet Number** 

. Development ່າດ0 SF)

Planning - (PLAN

County of San Diego, P

DWELLING UNIT

BUILDING DIVISION